



**HAL**  
open science

## Household Raw Wastewater Characterisation: quality, quantity and load of 15 facilities

L. Olivier, Catherine Boutin, Vivien Dubois

► **To cite this version:**

L. Olivier, Catherine Boutin, Vivien Dubois. Household Raw Wastewater Characterisation: quality, quantity and load of 15 facilities. Small Water and Wastewater systems, IWA, Oct 2018, Haifa, Israel. pp.1, 2018. hal-02608039

**HAL Id: hal-02608039**

**<https://hal.inrae.fr/hal-02608039>**

Submitted on 16 May 2020

**HAL** is a multi-disciplinary open access archive for the deposit and dissemination of scientific research documents, whether they are published or not. The documents may come from teaching and research institutions in France or abroad, or from public or private research centers.

L'archive ouverte pluridisciplinaire **HAL**, est destinée au dépôt et à la diffusion de documents scientifiques de niveau recherche, publiés ou non, émanant des établissements d'enseignement et de recherche français ou étrangers, des laboratoires publics ou privés.

# Household Raw Wastewater Characterisation: quality, quantity and load of 15 facilities

## Context

On-site sanitation facilities must be adapted to the pollution emitted by households of diverse occupancy rates. A study has been undertaken to understand the composition of raw wastewater at the household level.

The aim of this project is to study variations of daily flows, concentrations and daily loads in order to optimise design guidelines of on-site wastewater treatment devices.

## Material and methods

The pollution emitted by a household is difficult to measure because of legal (access to a private property) and technical limitations (heterogeneity of the influent). However, influents from 15 households were monitored for several years (302 24h-samples).

- 2 sampling methods: i) automatic flow composite samples from a pumping station and ii) storage of raw wastewater (Figure 1) and homogenization before sampling (Figure 2). See Table 1, sampling method (ii) is underlined.
- 6 physicochemical parameters analysed : TSS, COD, BOD<sub>5</sub>, NH<sub>4</sub><sup>+</sup>-N, TKN and TP. BOD<sub>5</sub> is the only parameter presented here.

## Daily flow and concentration per household

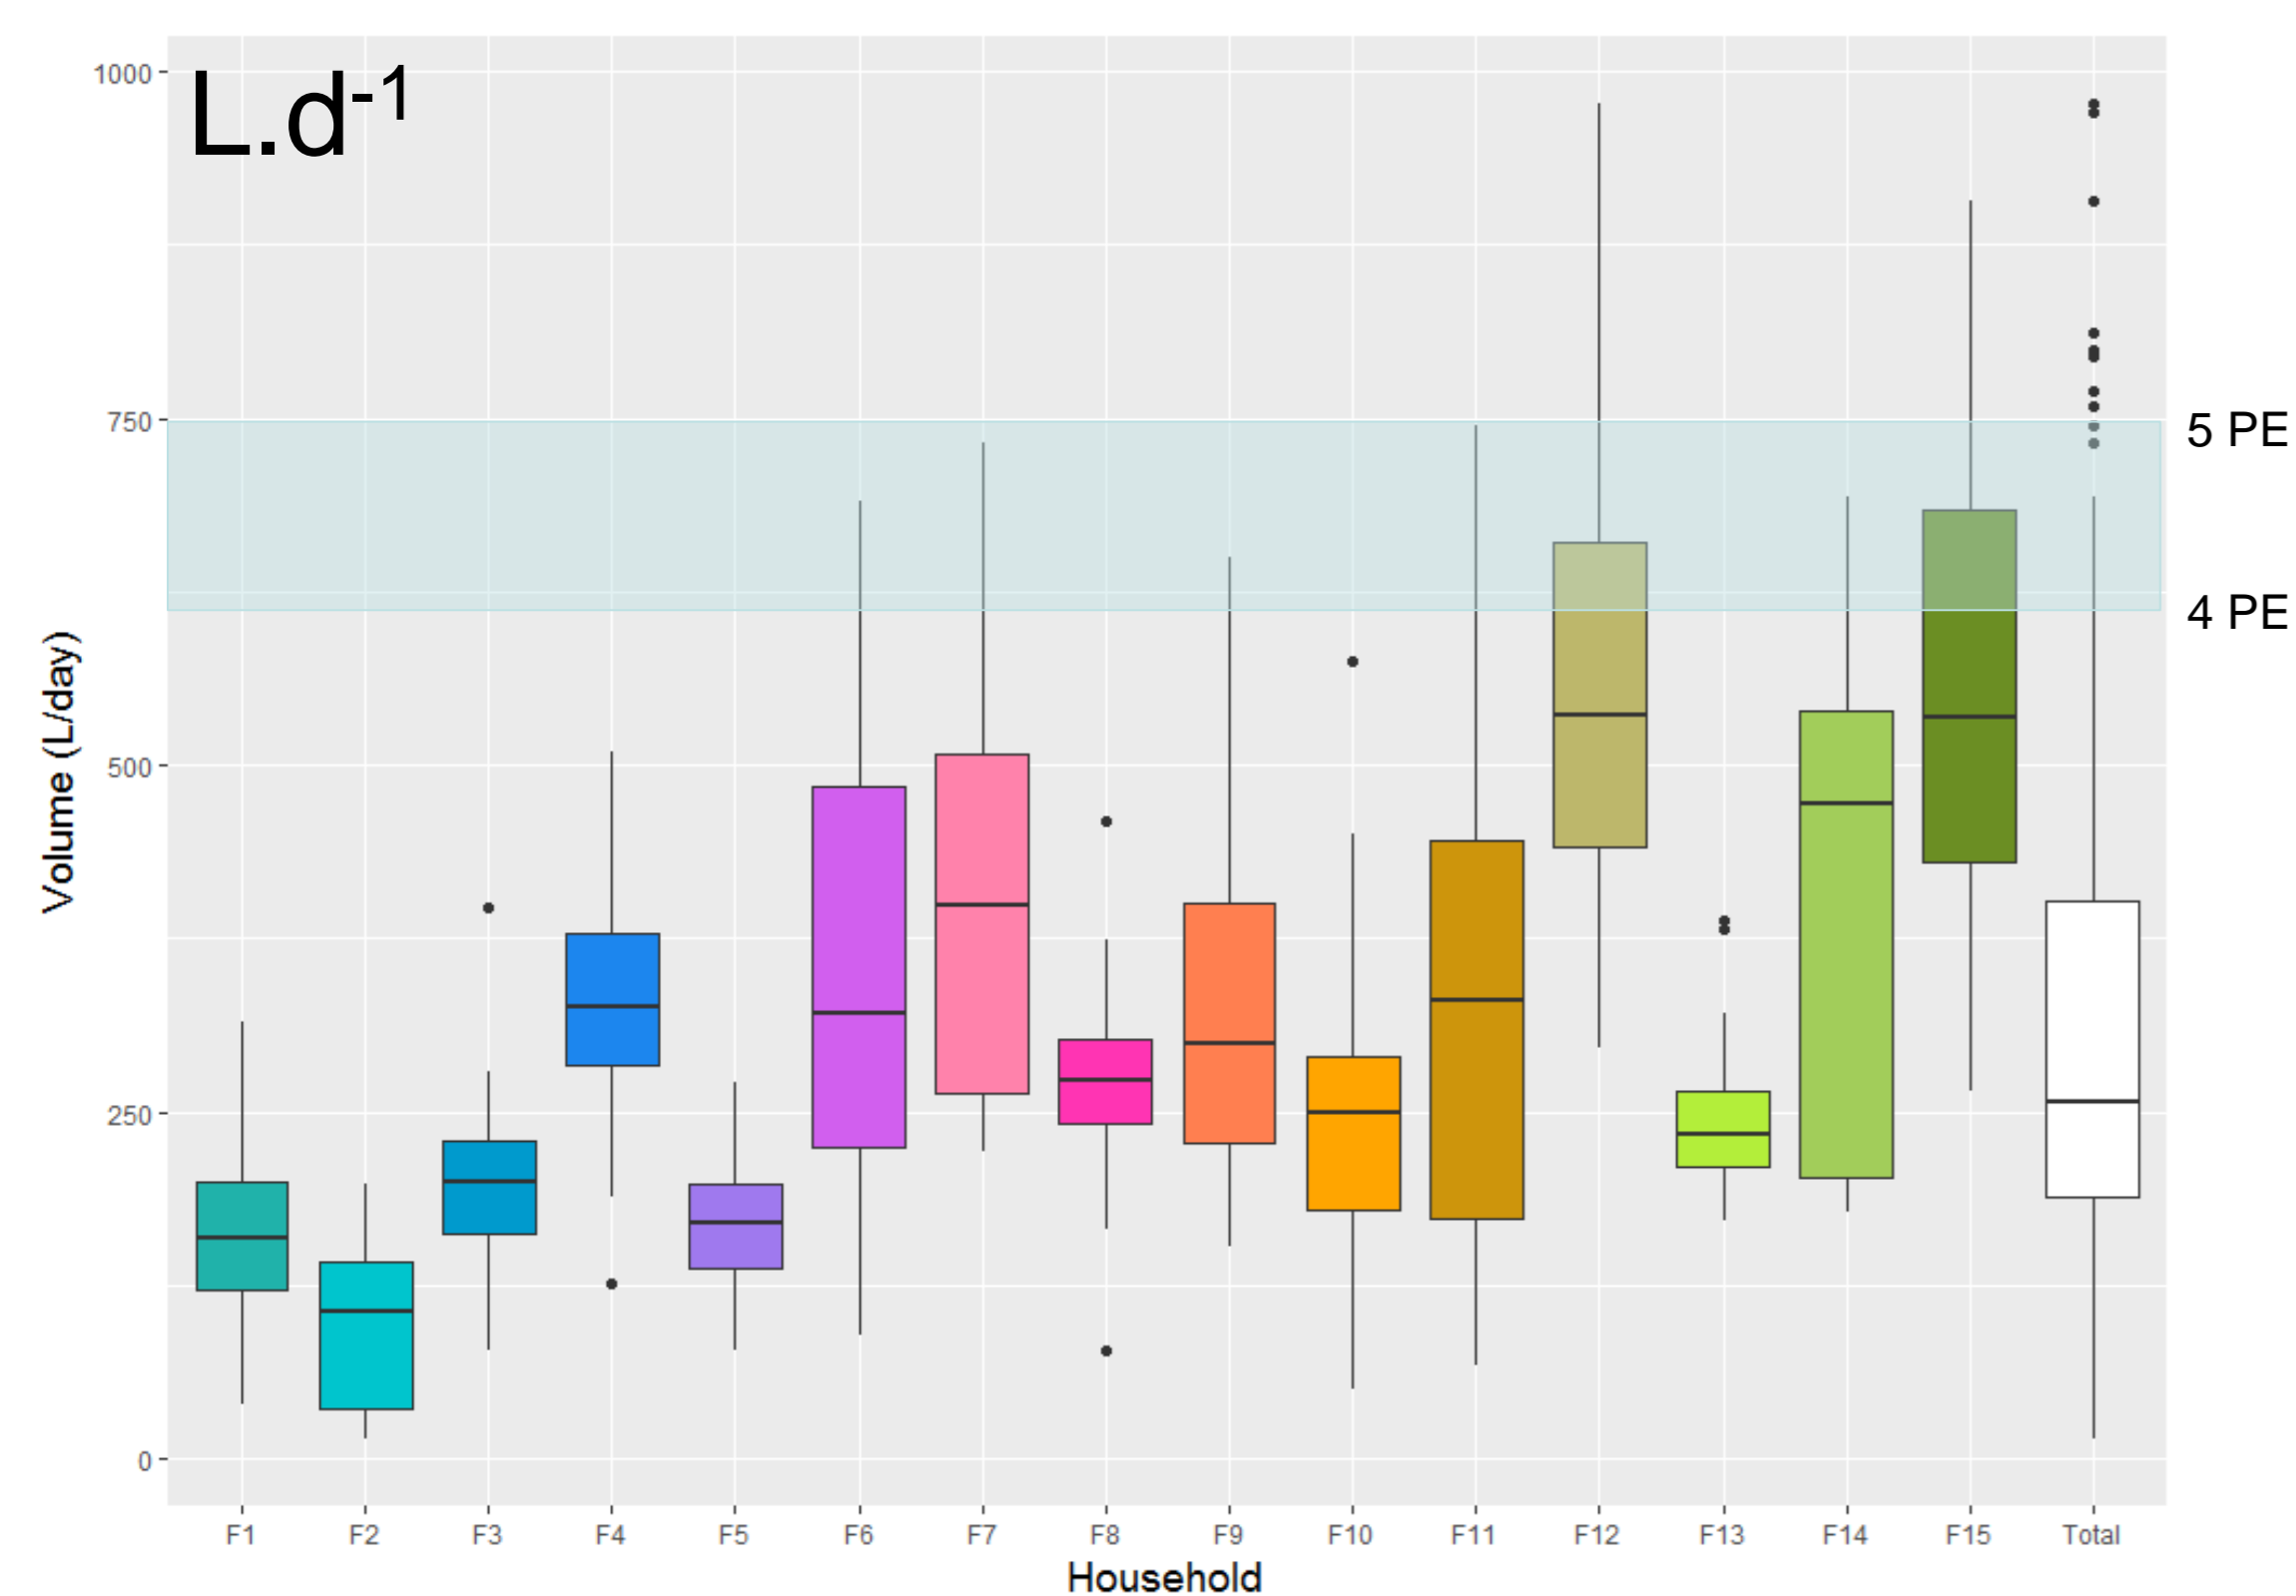


Figure 3. Daily flow per household

- Median daily flow per household: 106 (F2) to 536 L.d<sup>-1</sup> (F12)
- Range of variation per household (RSD) : 23% (F13) to 69% (F2)

The median daily flow of the total dataset is 260 L.d<sup>-1</sup> which is well below design guidelines used : 600-700 L.d<sup>-1</sup> for a household of 4 – 5 people (highlighted in Figure 3).

## BOD<sub>5</sub> Organic load per household

- Median daily load per household: 24 (F2) to 280 g.d<sup>-1</sup> (F7)
- Range of variation per household (RSD) : 32% (F15) to 127% (F1)

The median daily load of the total dataset is 140 g.d<sup>-1</sup> which is below design guidelines used : 240 – 300 gBOD<sub>5</sub>.d<sup>-1</sup> for a household of 4 - 5 PE (highlighted in Figure 5).

The on-site treatment systems must be designed to account for the highly varying loading observed.

## Conclusions and perspectives

This observation of very large variations in flow, concentration and also, in organic load at the household scale confirms the validity of the question concerning the most adapted design basis for onsite wastewater treatment systems.

Hydraulic and organic loads are not directly related to the household occupancy rate. A complementary analysis of the loads expressed in g.capita<sup>-1</sup>.day<sup>-1</sup> shall be conducted and compared to international standards (PE).

Table 1. Description of households

Household	Adult + Child	Number of sample
F1	<u>1 + 0</u>	34
F2	2 + 0	10
F3	2 + 0	17
F4	2 + 0	18
F5	2 + 0	14
F6	2 + 1	26
F7	<u>2 + 1</u>	14
F8	2 + 2	8
F9	2 + 2	35
F10	<u>2 + 3</u>	25
F11	2 + 4	30
F12	2 + 4	29
F13	3 + 1	21
F14	3 + 1	7
F15	3 + 2	14
<b>Total</b>		<b>302</b>

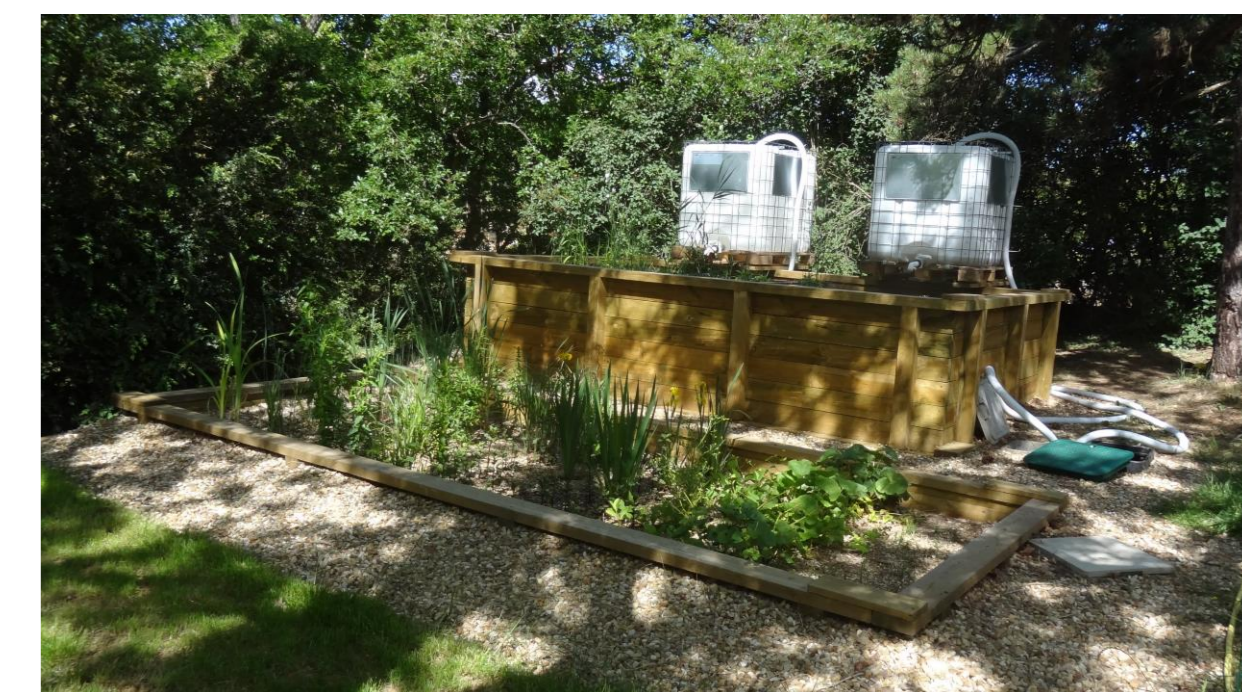


Figure 1. Daily storage



Figure 2. Homogenization and sampling

Table 2. Daily flow and BOD<sub>5</sub> concentration

Raw wastewater	Flow (L.d <sup>-1</sup> )	BOD <sub>5</sub> (mg.L <sup>-1</sup> )
Mean	311	514
<b>Median</b>	<b>257</b>	<b>412</b>
Minimum	14	37
Maximum	977	3380
RSD*	59%	75%
Nb of data	291	226

\*Relative Standard Deviation

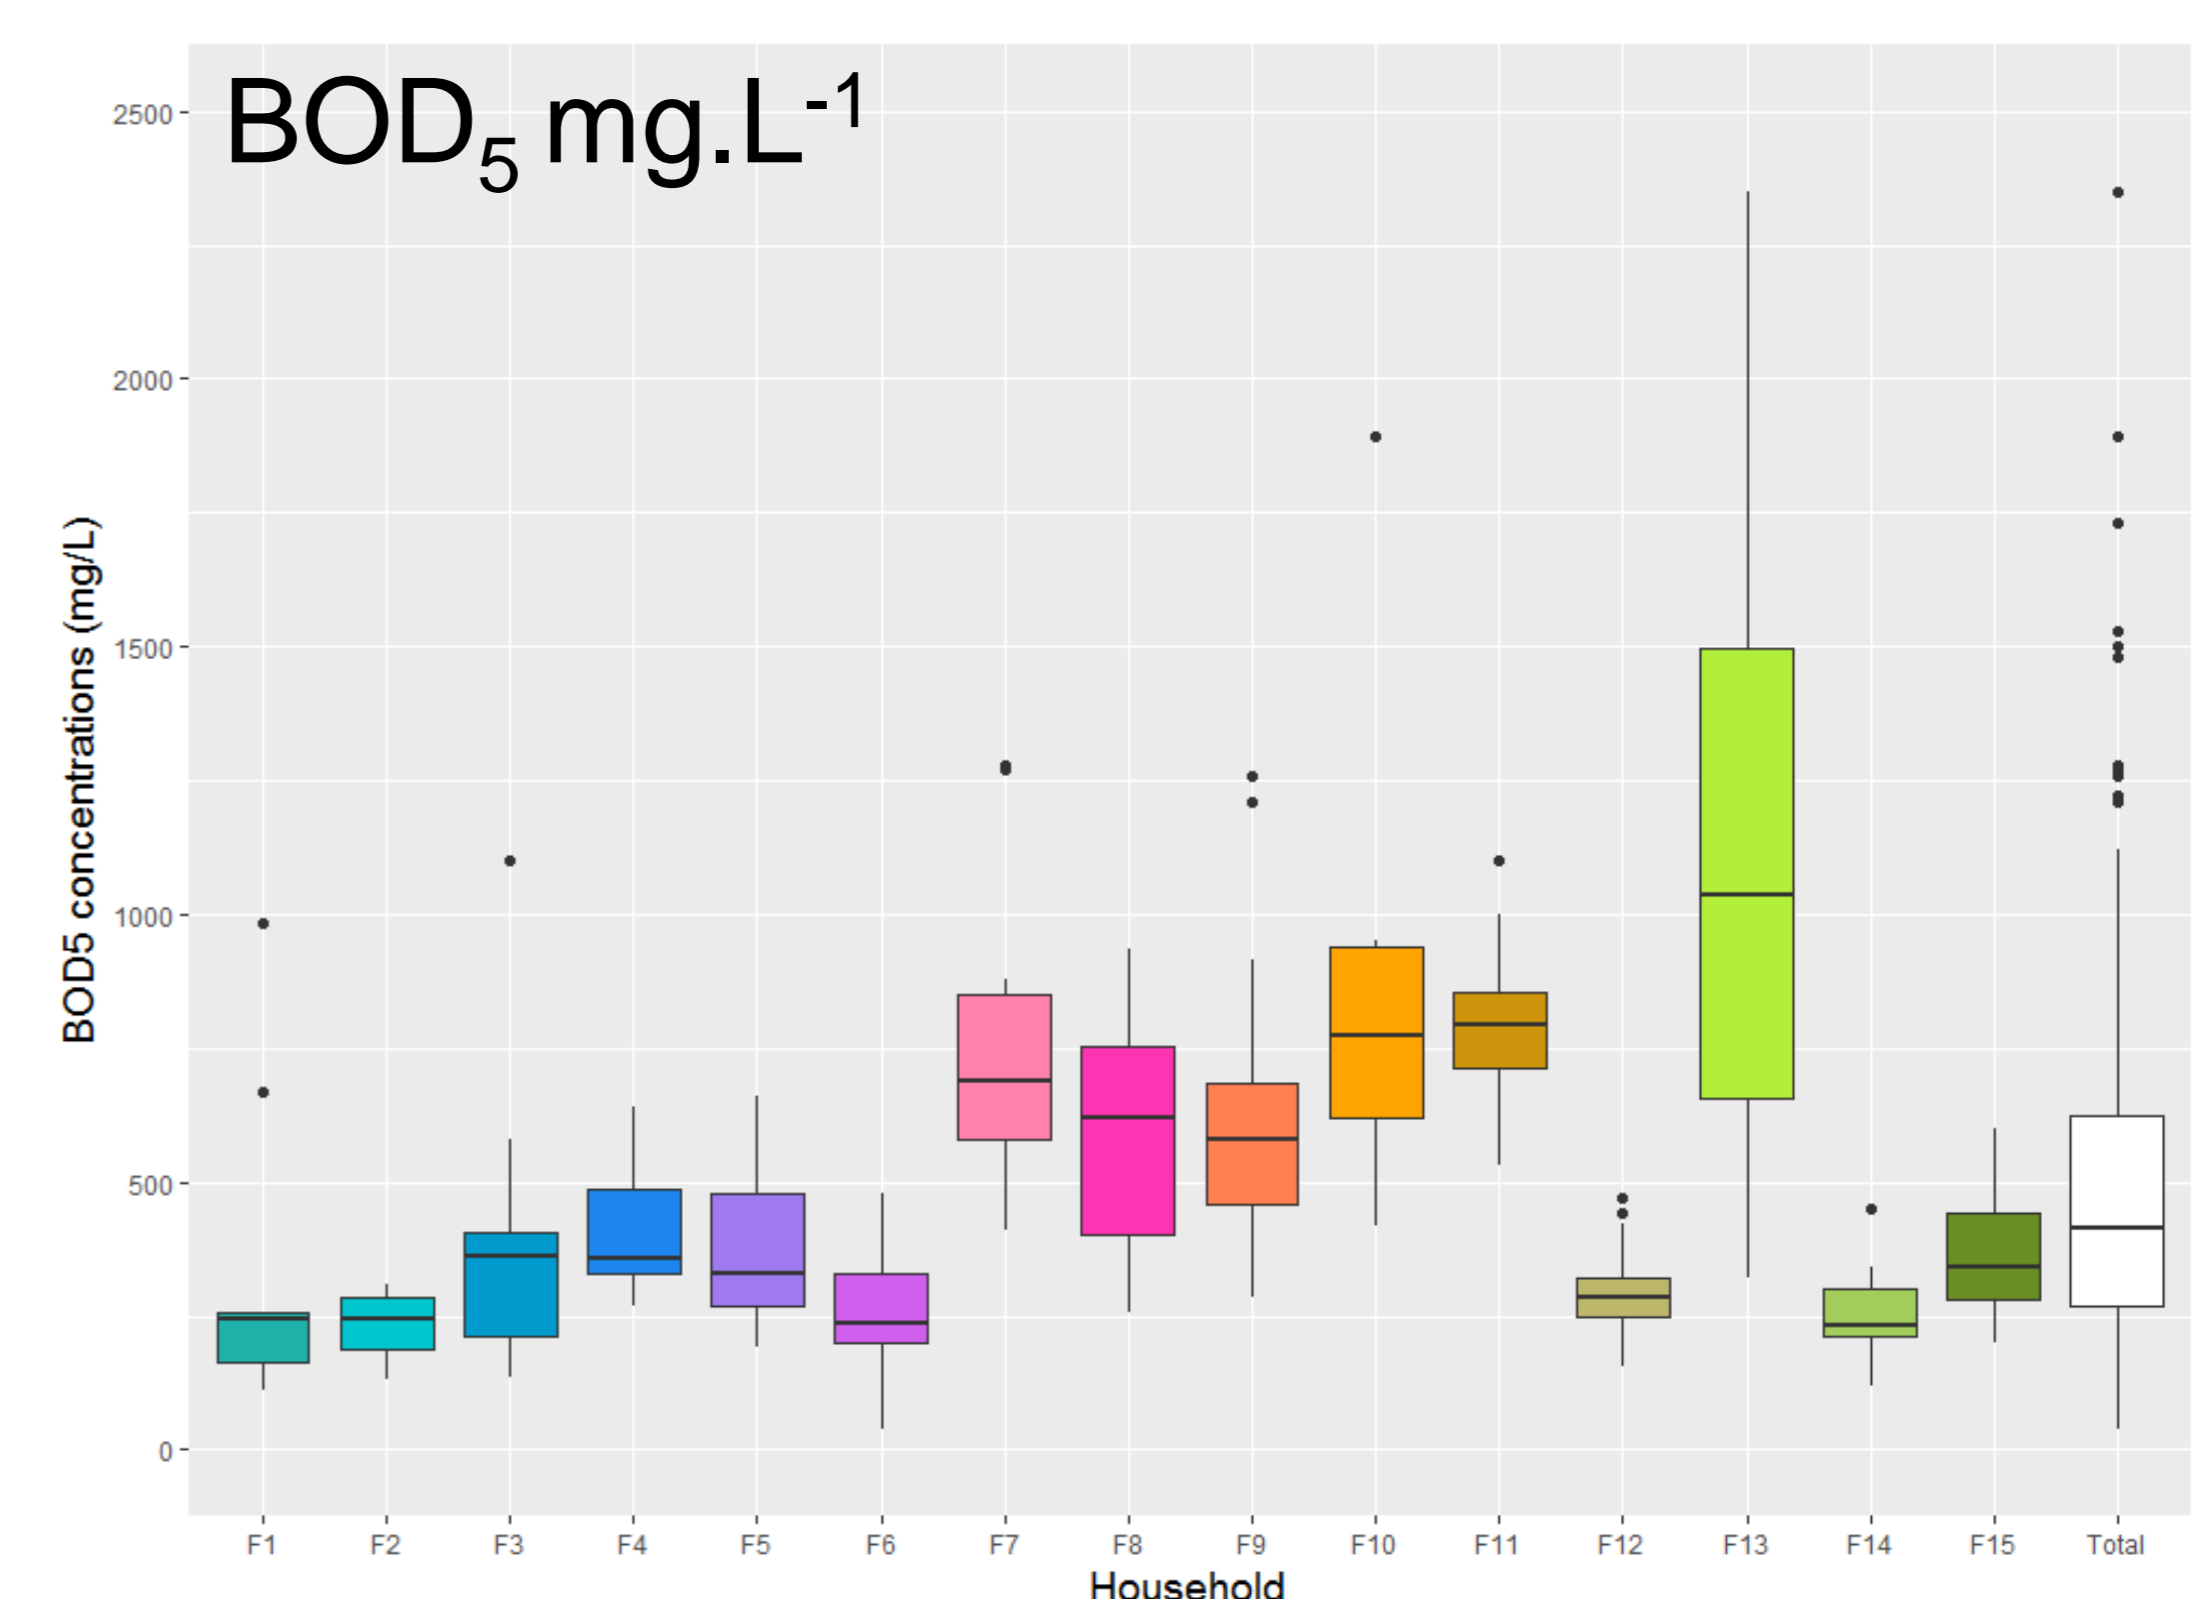


Figure 4. BOD5 concentration per household

- Median BOD<sub>5</sub> concentration per household: 230 (F14) to 1035 mg.L<sup>-1</sup> (F13)
  - Range of variation per household (RSD) : 22% (F11) to 87% (F1)
- RSD per household for concentration and volume are similar.

Table 3. BOD<sub>5</sub> daily loads

Raw wastewater	BOD <sub>5</sub> (g.d <sup>-1</sup> )
Mean	155
<b>Median</b>	<b>140</b>
Minimum	3
Maximum	938
RSD*	79%
Nb of data	223

\*Relative Standard Deviation

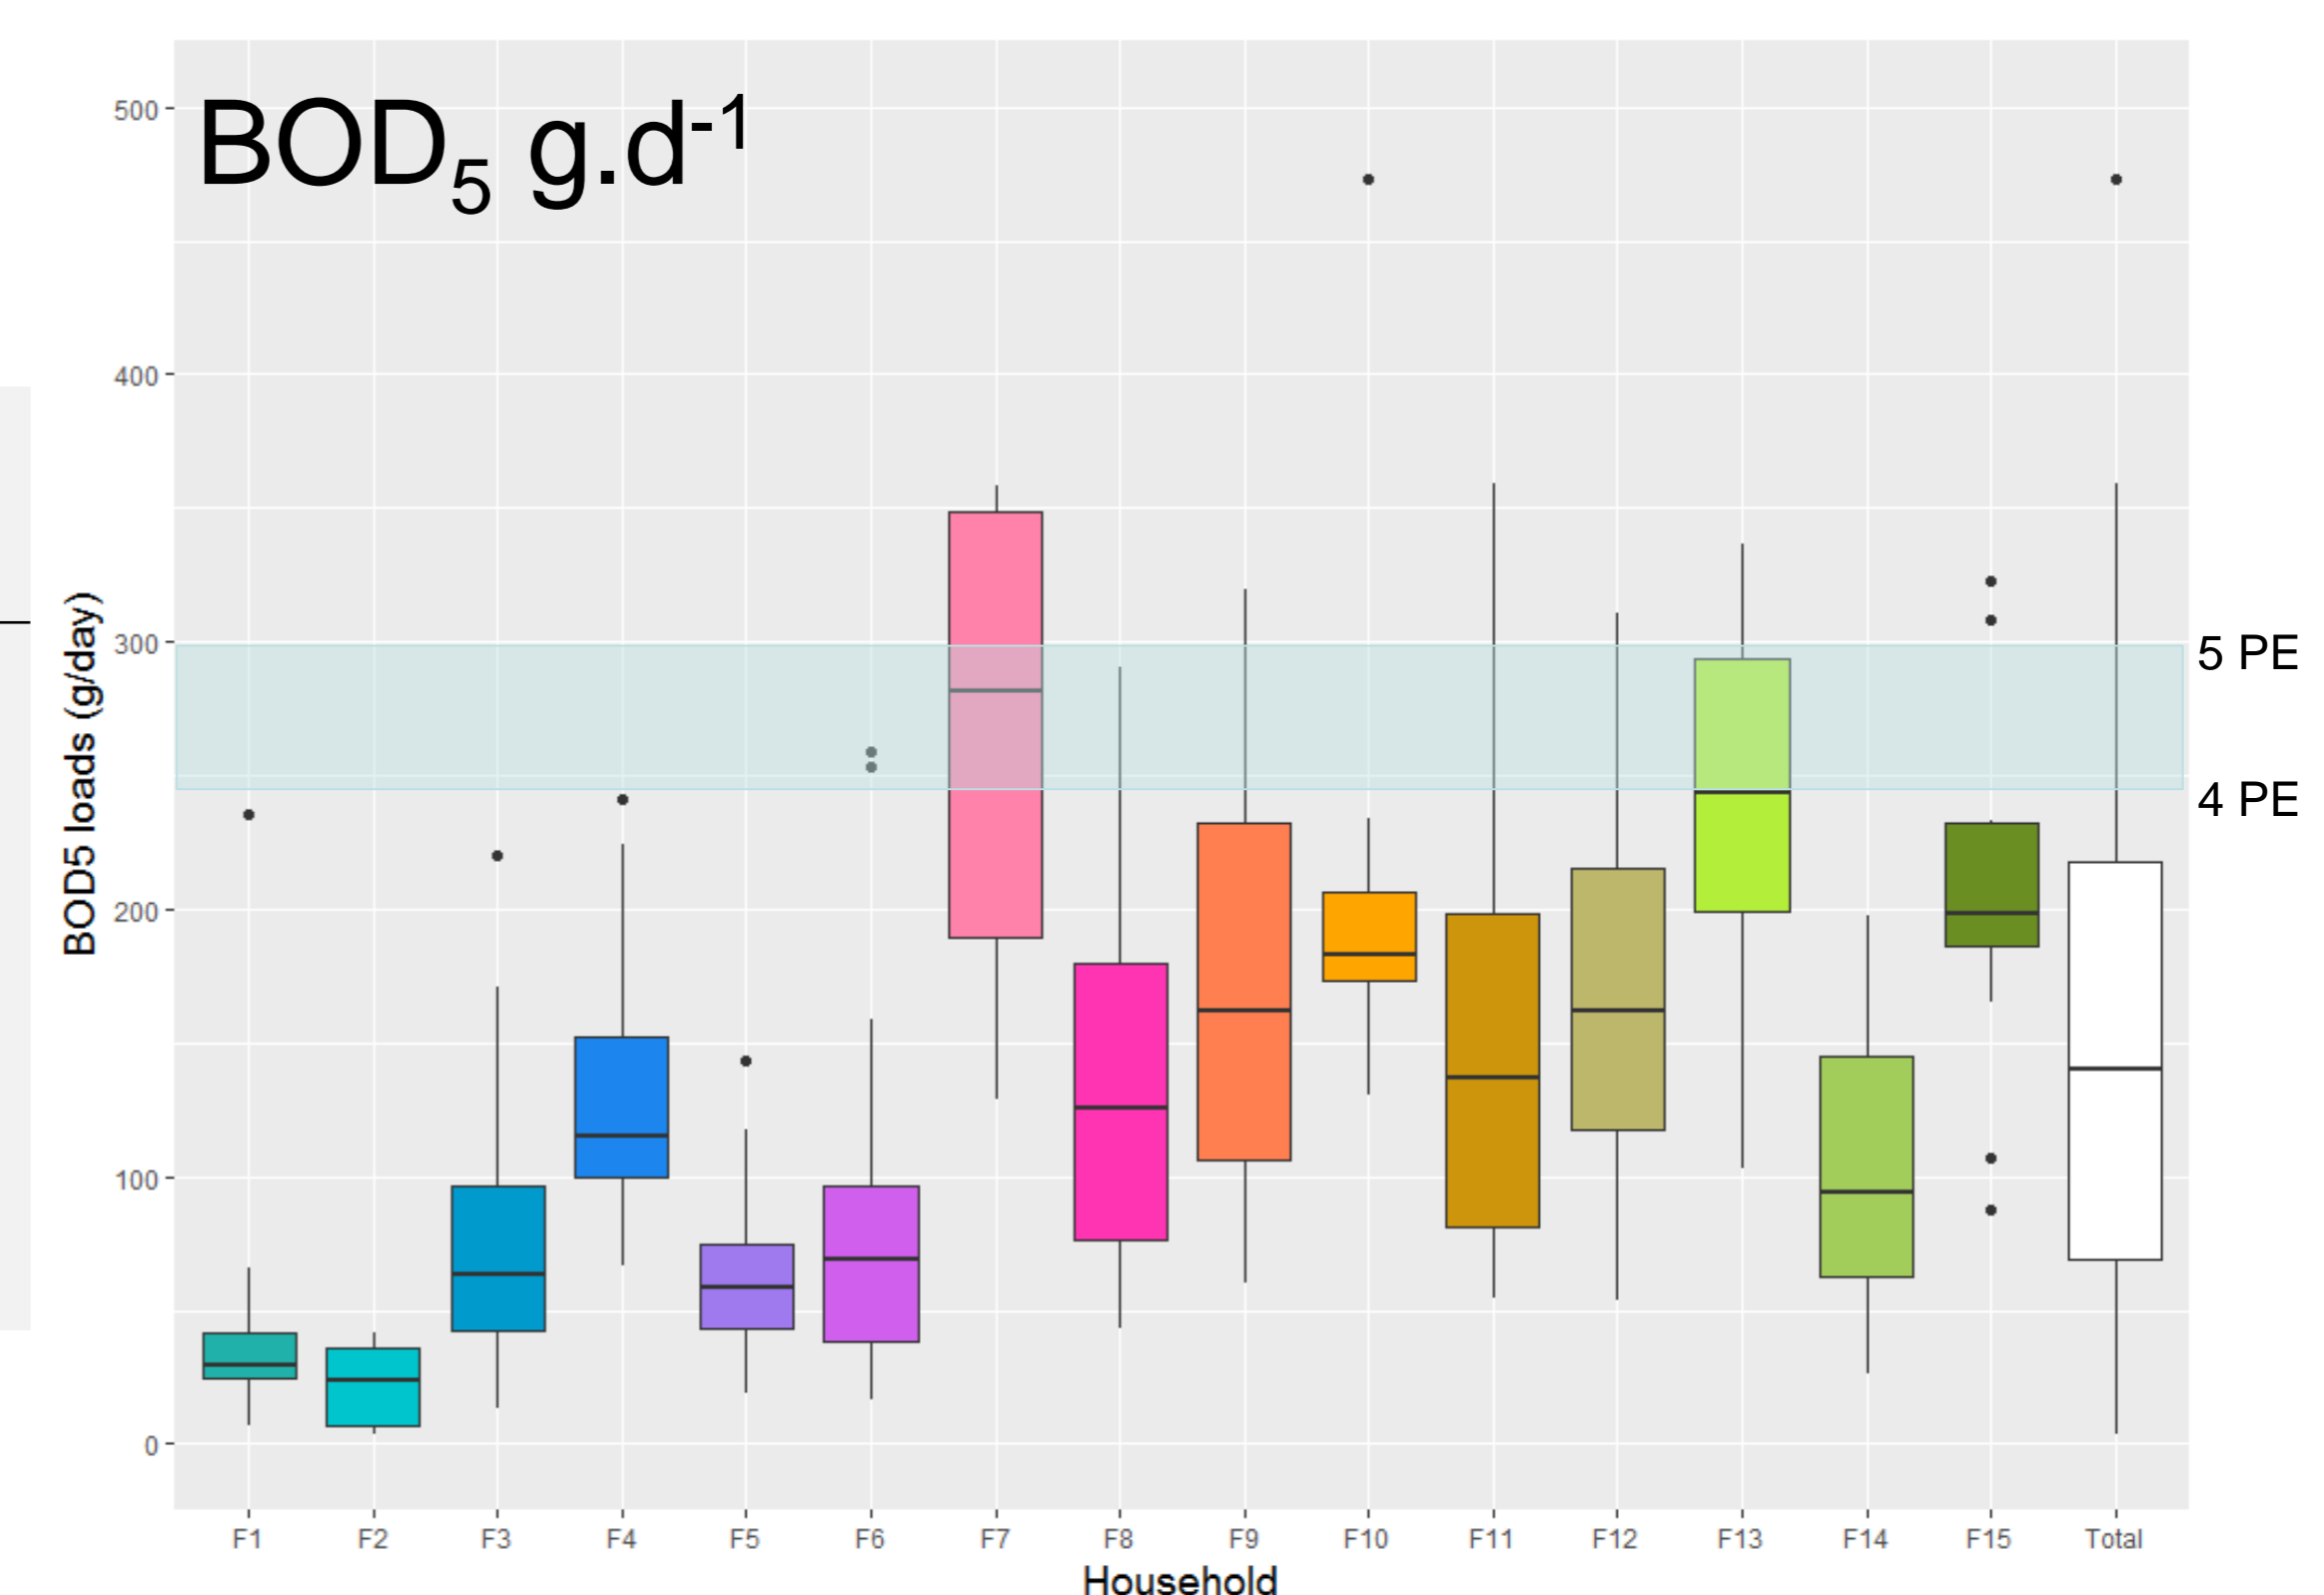


Figure 5. BOD<sub>5</sub> daily loads per household